


REVISIONS			
REV	DESCRIPTION	DATE	REV BY
0	INITIAL ISSUE	08-05-03	TC

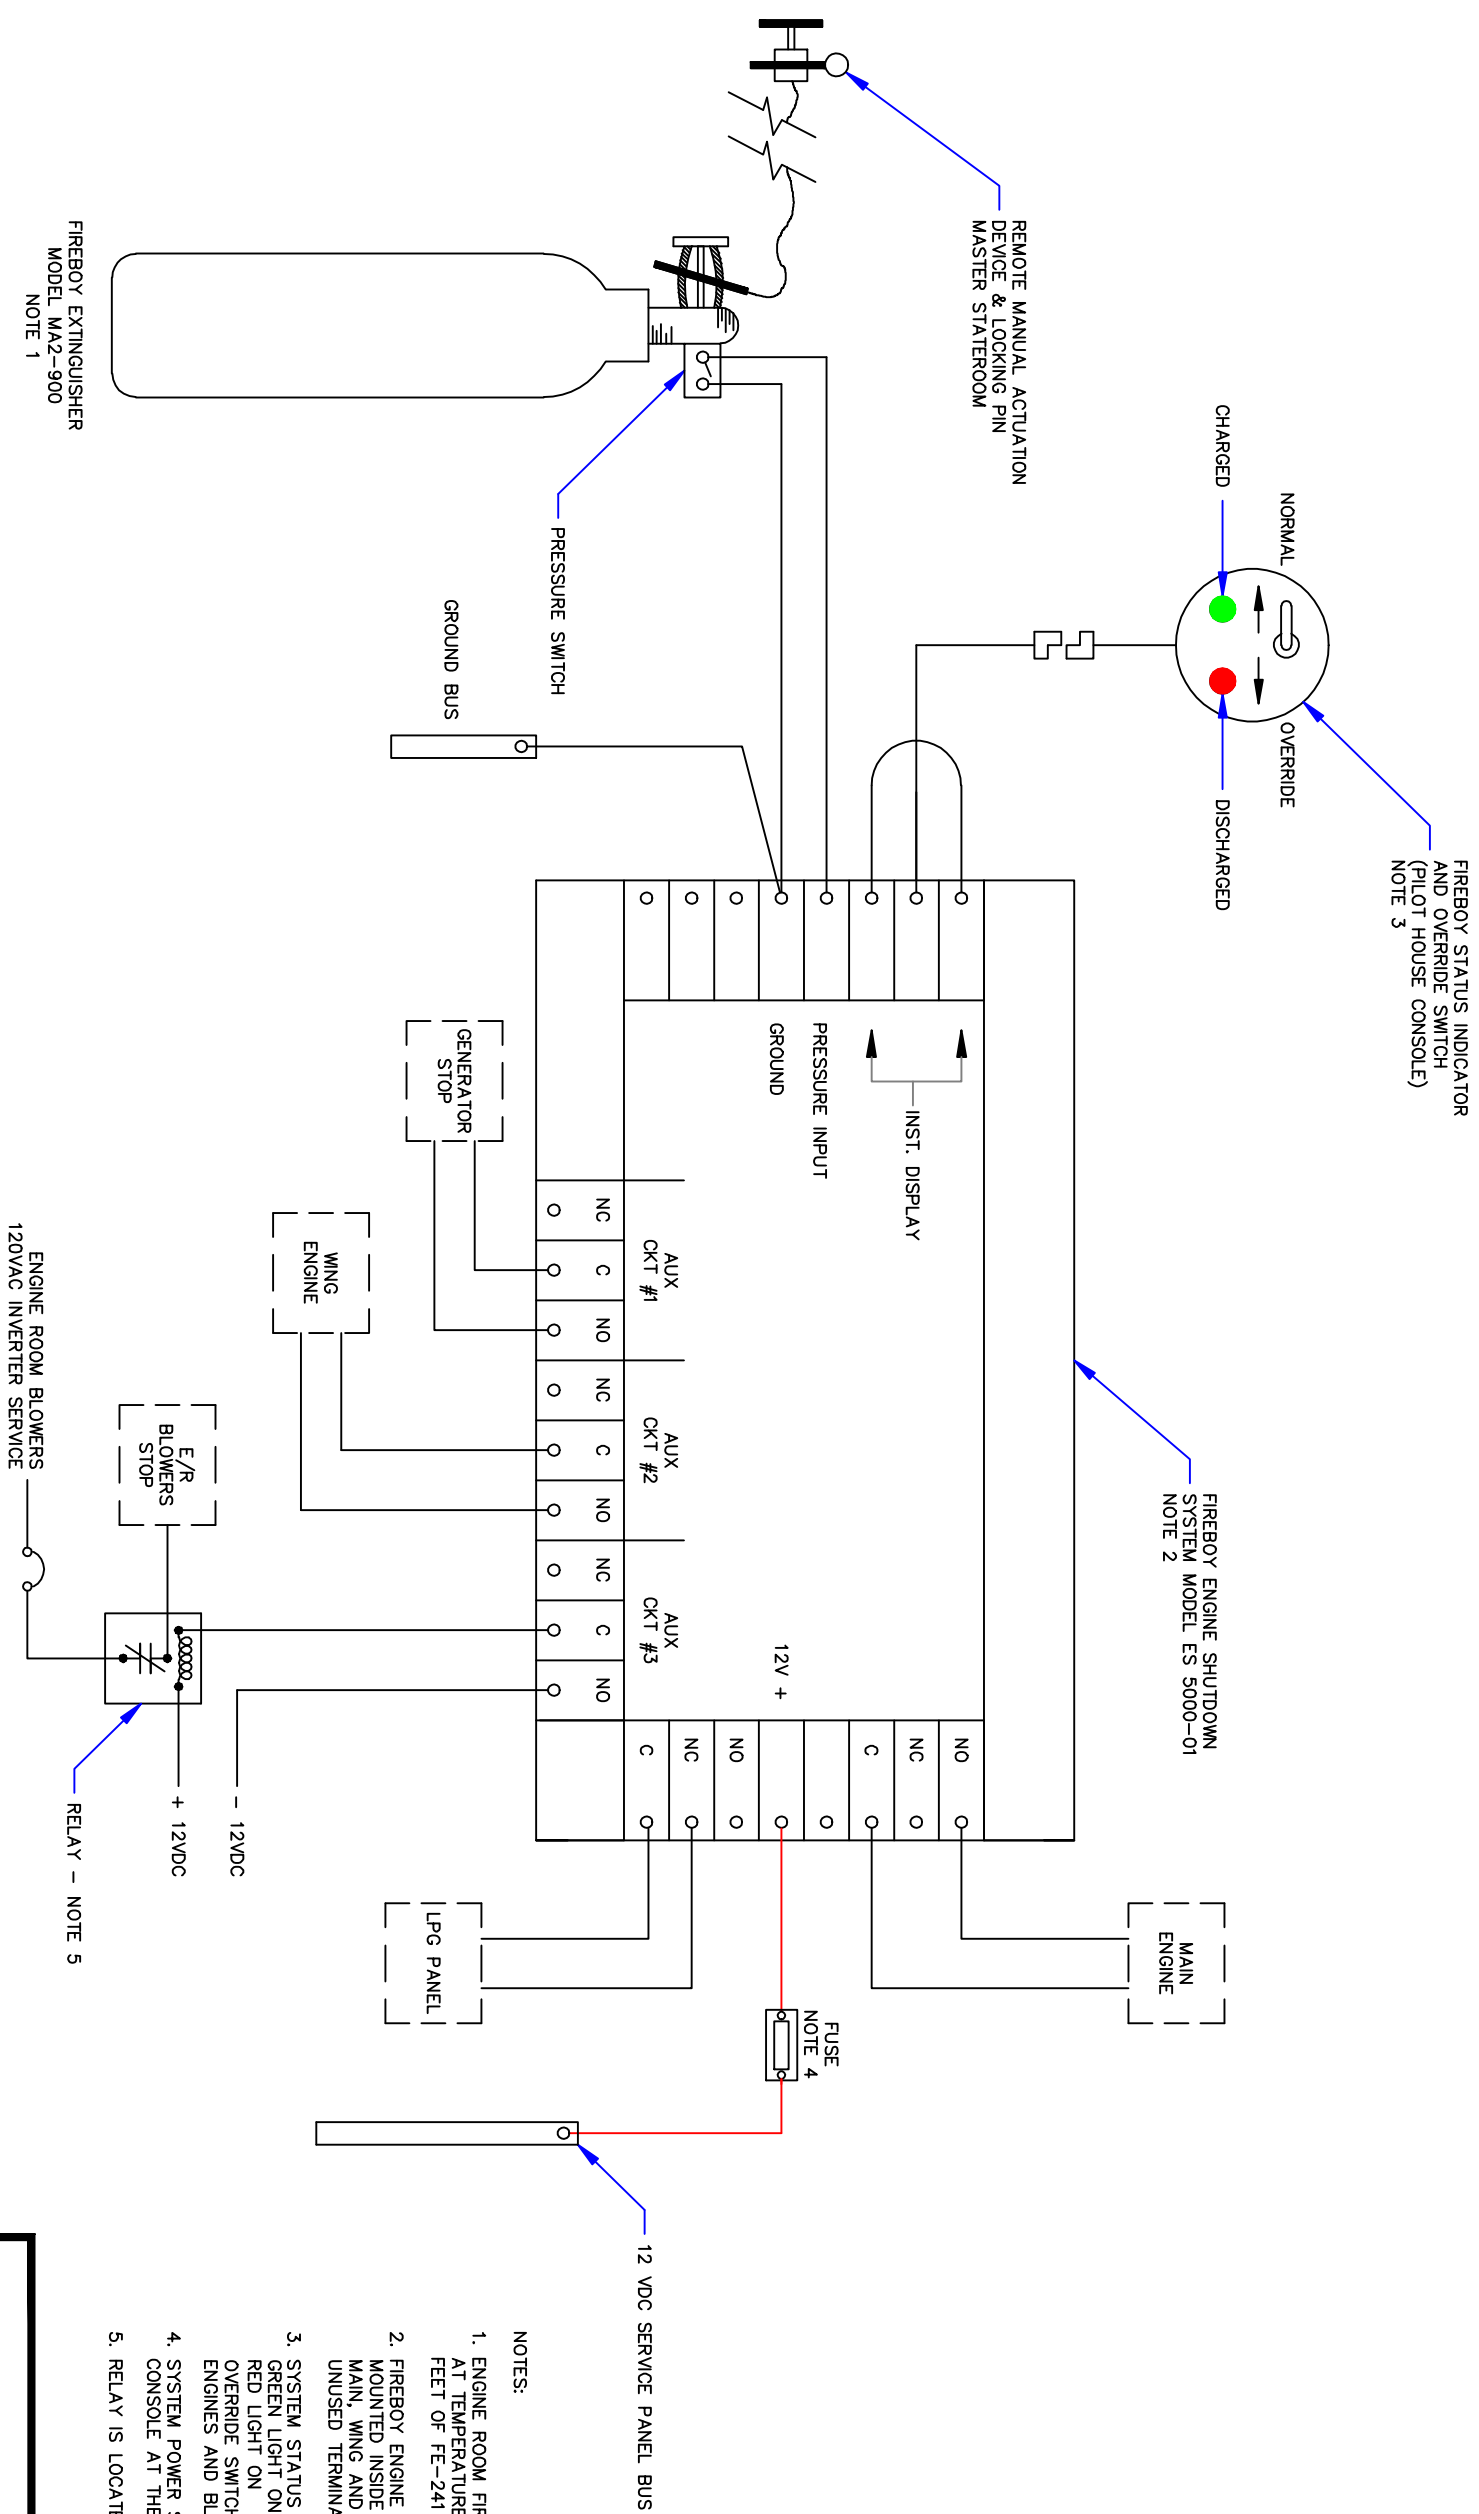

- NOTES:
1. ENGINE ROOM FIREBOY EXTINGUISHER SELF ACTUATES AT TEMPERATURE ABOVE 175F. CAPACITY 900 CUBIC FEET OF FE-24T EXTINGUISHING AGENT.
 2. FIREBOY ENGINE SHUTDOWN SYSTEM RELAY MODULE MOUNTED INSIDE THE PILOT HOUSE CONSOLE. ACTUATION STOPS MAIN, WING AND GENERATOR ENGINES AND ENGINE ROOM BLOWER. UNUSED TERMINALS NOT SHOWN.
 3. SYSTEM STATUS INDICATION:
GREEN LIGHT ON = NORMAL (CHARGED)
RED LIGHT ON = DISCHARGED (ACTUATED)
OVERRIDE SWITCH POSITION BYPASSES SHUTDOWN MODE TO ALLOW ENGINES AND BLOWER TO RESTART.
 4. SYSTEM POWER SUPPLY FUSE IS LOCATED INSIDE PILOT HOUSE CONSOLE AT THE SHUTDOWN MODULE.
 5. RELAY IS LOCATED ON FORWARD BULKHEAD.

NORDHAVN 50 FIRE PROTECTION SYSTEM

PACIFIC ASIAN ENTERPRISES

PO BOX 874, AT-THE HARBOR, DANA POINT, CALIFORNIA 92629
 PH (949)496-4848 FAX (949)240-2398

SIZE	PRJ. NO.	DWG. NO.	DWG.
B	N5025	N50FPS-5025	TC
SCALE:	NTS	DATE: SEE ABOVE	REV: SEE ABOVE
		SHEET: 1 OF 1	